
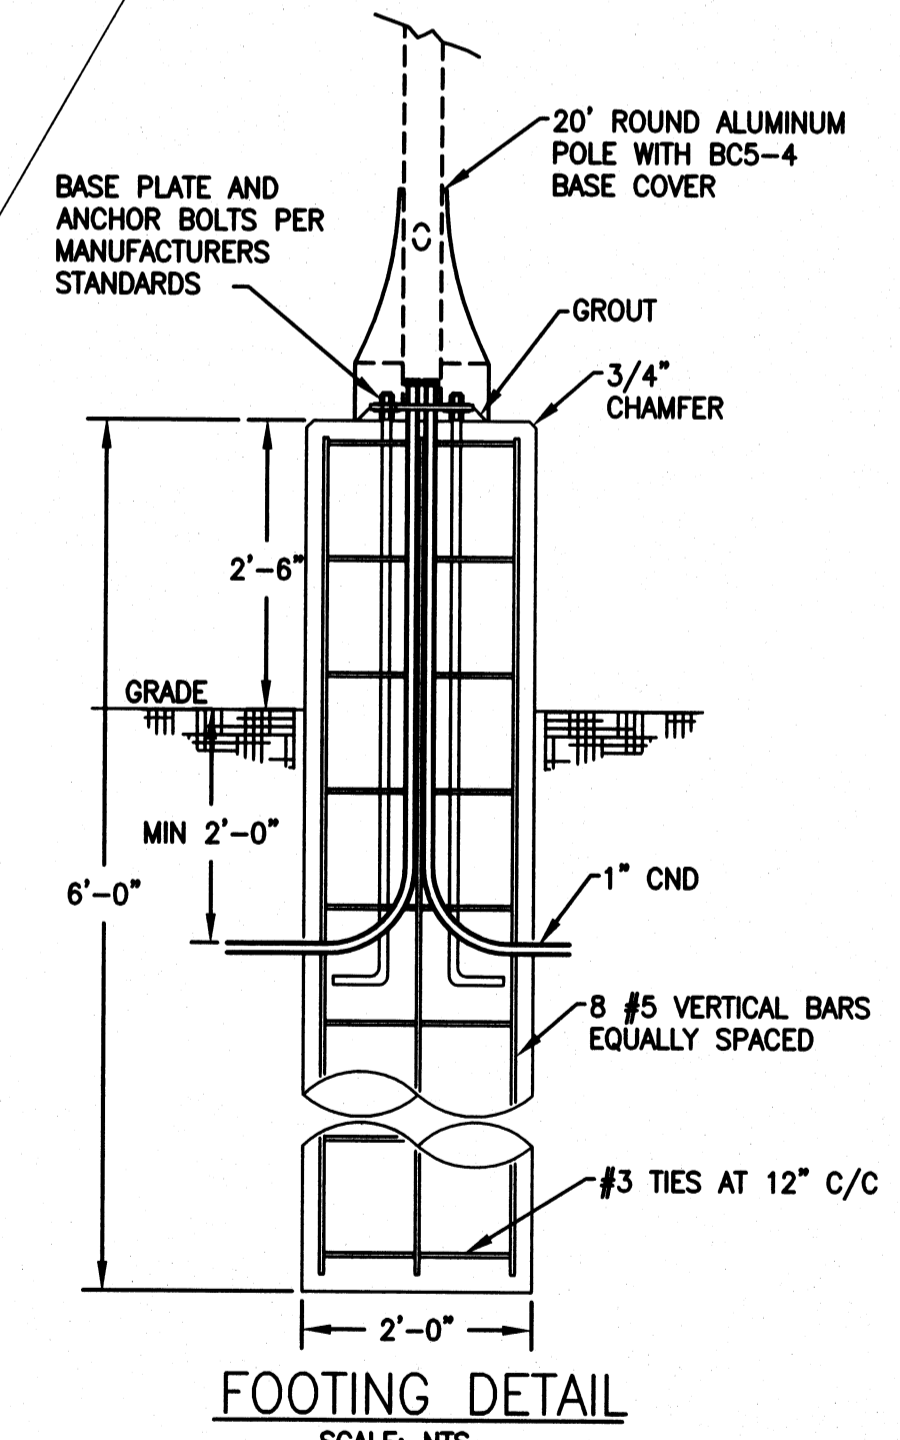


NOTES:

1. REMOVE EXISTING LIGHTS AND WOOD POLES. REMOVE CONDUCTORS AND J-BOXES AND ABANDON CONDUITS. LABEL CIRCUITS IN SERVICE PANEL LOCATED IN HOTEL BUILDING AS 'SPARE'.
2. EXTEND EXISTING STREET LIGHT CIRCUIT TO NEW LIGHT POLES. ROUTE TO MINIMIZE ROADWAY CUTS. INSTALL J-BOXES AS REQUIRED.
3. CONTRACTOR IS RESPONSIBLE FOR REPAIRING PAVEMENT OVER TRENCHES PER CITY OF KENNEWICK SPECIFICATIONS. CONTRACTOR SHALL RESTORE ALL CURBING, LANDSCAPING, RIVER ROCK AND ANY OTHER DISTURBED MAN-MADE OR NATURAL FEATURES/STRUCTURES TO THE OWNER'S SATISFACTION.
4. PROVIDE AND INSTALL ONE NEW LOCKABLE, OVERRIDE CONTROL SWITCH IN WEATHERPROOF ENCLOSURE (HUBBELL ADVANTAGE CIRCUIT-LOCK HBL13R12D OR EQUAL) FOR MANUAL CONTROL OF NORTH PARKING ISLAND LIGHT POLES AND FIXTURES (TOTAL OF 4 POLES).
5. CONTRACTOR TO VERIFY AVAILABLE SERVICE VOLTAGE PRIOR TO ORDERING NEW LIGHT FIXTURES AND DEVICES.

LEGEND

- ⊙ ⊙ PARKING LOT LIGHT - DOUBLE
- ⊙ EXISTING LIGHT
- EXISTING POWER
- NEW POWER
- R EXISTING TO BE REMOVED

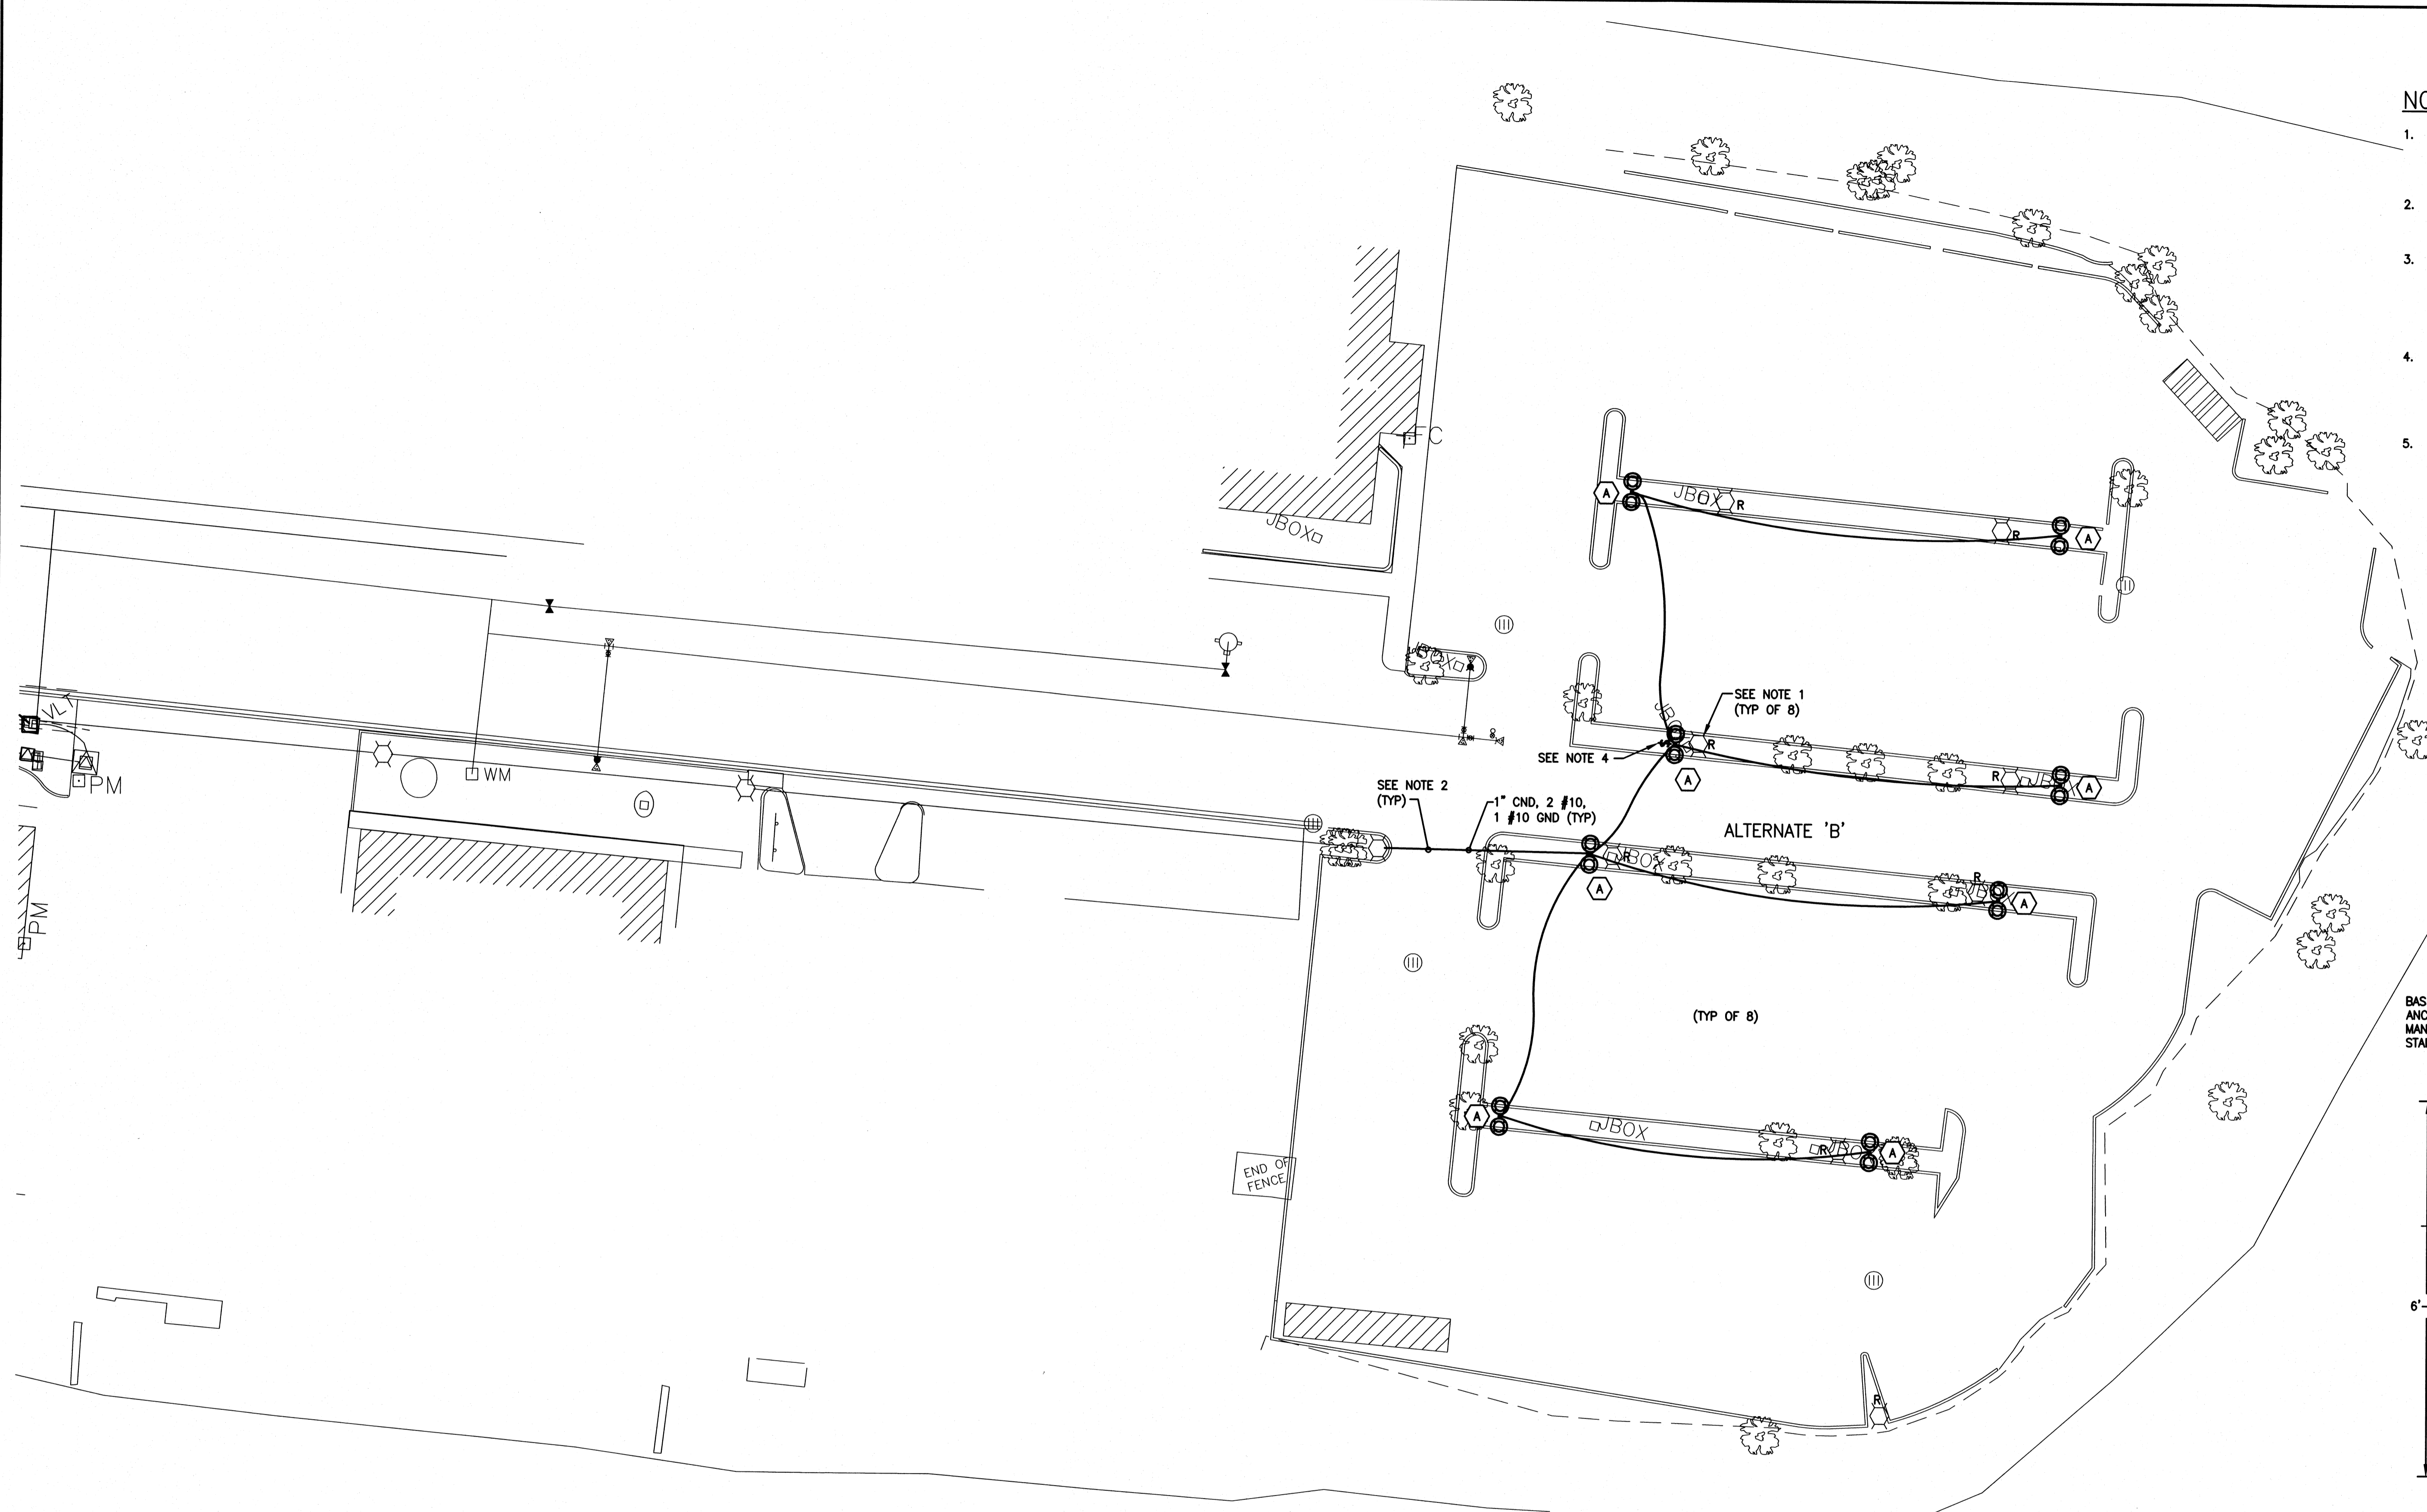


LIGHTING FIXTURE SCHEDULE						
NAME	MANUFACTURER		FIXT. VA	LAMP TYPE	MOUNTING	REMARKS
	CATALOG NO.					
(A) AAL	SP1-ANG-GR5-175MH-RAL#7044-COP-TAP1-BC5-4		402	175W MH	20' POLE	MATCH PEDESTAL MOUNTING WITH EXISTING TWO-LAMP POLES. POLES AND LUMINAIRES SHALL MATCH EXISTING STANDARDS IN ADJACENT PORT BUILDING PARKING LOT
VALMONT	2000-40406S4-RAL#7044					

OWNER TO PROVIDE CUSTOM COPPER TOP HOOD AND BRACKET TO SHIELD UPLIGHT, IDENTICAL TO EXISTING LIGHT FIXTURES.



SCALE: 1" = 20'

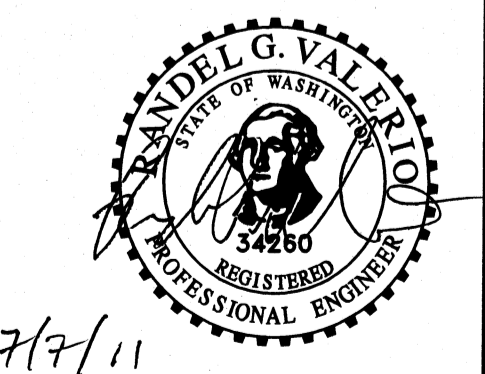

7/7/11

REV	REVISION DESCRIPTION	DATE

DITTLE & ASSOCIATES, INC.
 Engineers and Consultants
 7515 WEST DESCHUTES AVENUE
 KENNEWICK, WA 98338
 (360) 735-8230

HALL ENGINEERING ASSOCIATES
 PORT OF KENNEWICK
 CLOVER ISLAND PARKING LOT
 DWN BY: AMM DSN BY: RGV CHK BY: RGV

LIGHTING PLAN
ALTERNATE 'B'
 DATE: 7/7/2011 PROJ. # HAL 100501 DWG: E2 0